

REQUIRED LIFT STATION INFORMATION

PUMP DATA:





MANUFACTURER, _____
 MOD. No. _____ IMP. No. _____ MOTOR, _____ HP, _____
 RPM, _____ VOLTS, _____ PHASE, 60 HERTZ

OPERATING CONDITIONS:

_____ GPM AT _____ TDH.
 _____ % EFFICIENCY

WET WELL:

SIZED FOR MINIMUM PUMP CYCLE TIME OF 210 MINUTES AND A MAXIMUM OF 16 PUMP STARTS PER HOUR. WORKING DEPTH _____ FT. WORKING VOLUME _____ GALS.

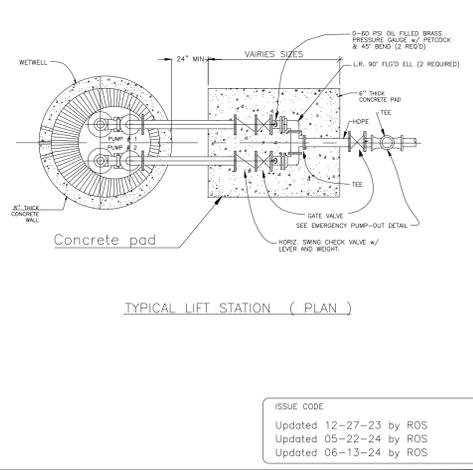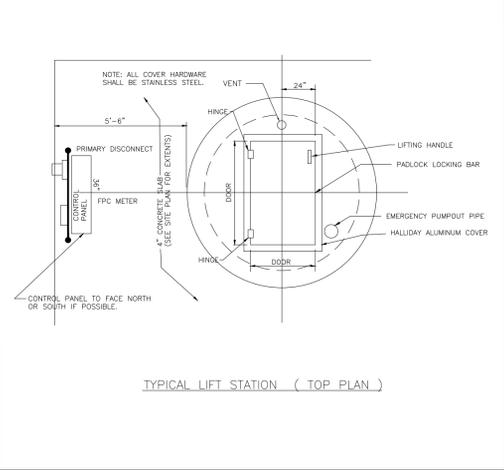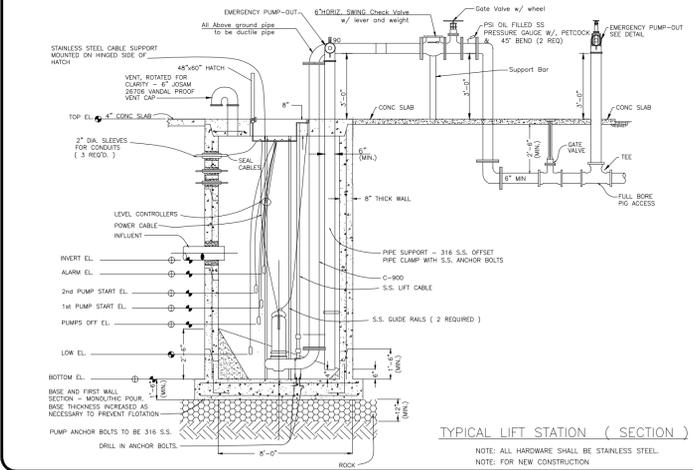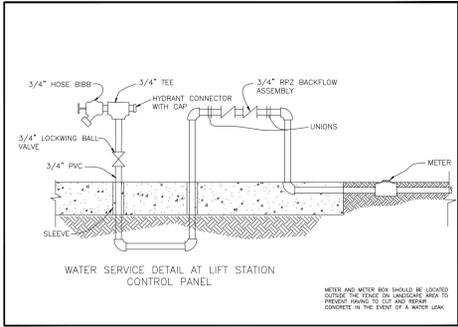

CITY OF LAKE WALES
 "Crown Jewel of the Ridge"

ISSUE CODE: [A] PRELIMINARY [B] DESIGN [C] BIDS [D] CONSTRUCTION [E] APPROVAL
 DESIGN: _____ AND CHK'D BY: _____ SCALE: _____ NTS
 DATE: _____
 DRAWN BY: _____ ENGR.
 DRAWING TITLE: **LIFT STATION DETAILS**
 JOB NO. _____
 AREA: _____ CITY-OF-LAKE-WALES
 REV. _____